


# Off Premise Signaling Module

## 3-OPS

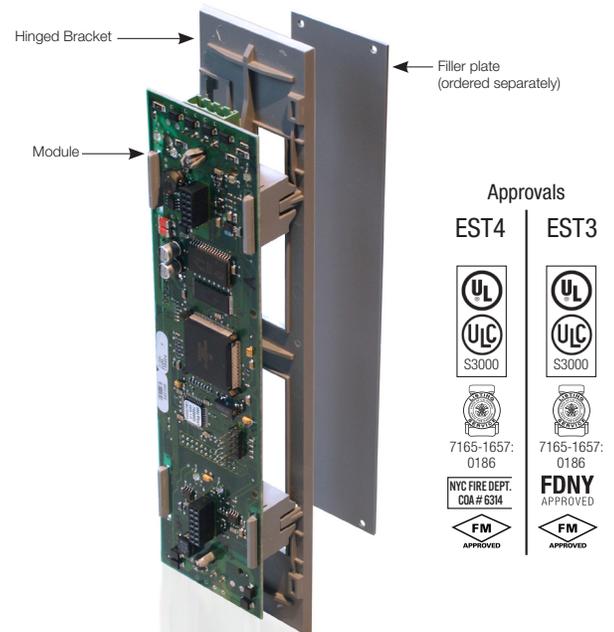

### Overview

The 3-OPS configures for “old” or “new” styles of reverse polarity central station operation. Removable terminal blocks allow isolation of field wiring without having to remove individual wires. This feature helps make service and isolation of field wiring for trouble shooting easy. The 3-OPS off premises signaling module is a local rail module and will support any Control Display module mounting to its front giving exceptional flexibility to system user interface layout.

### Standard Features

- Reverse polarity outputs for Alarm Supervisory and Trouble
- City Box operation

### Application

The 3-OPS supports three separate off premises signaling modes of operation.

- 1) The first or “old” style reverse polarity operation has only the alarm relay active. In the normal state the alarm output is 24 Vdc current limited to 6mA. In the alarm state the polarity reverses. Should the EST3 panel go into trouble from the normal state, the voltage is removed from the output terminals of the 3-OPS the change will be detected by the central station as a trouble. Alarm always has priority over trouble. Trouble relay contacts must be configured for normally closed operation.
- 2) The second operation “new” style allows the 3-OPS to output three independent reversing polarity signals. These are alarm, supervisory, and trouble. In each case an active condition causes the terminal output voltage to reverse. Should the central station detect a loss of voltage the condition is due to line failure. When configured for “new” style operation a set of form C trouble contacts are available.
- 3) The 3-OPS will also support a City Tie connection. In this configuration the 3-OPS has terminals for a local energy master fire alarm box. The module operates into a 14 ohm coil and supervises the city tie connection for open conditions. Trouble relay contacts are configurable for normally open or normally closed.




**Contact us**

Phone: 800-655-4497 (Option 4)  
 Email: [edwards.fire@kgsolutions.com](mailto:edwards.fire@kgsolutions.com)  
 Website: [edwardsfiresafety.com](http://edwardsfiresafety.com)

8985 Town Center Pkwy  
 Bradenton, FL 34202

©2025 Walter Kidde Portable Equipment, LLC.  
 All Rights Reserved.

## Typical Wiring

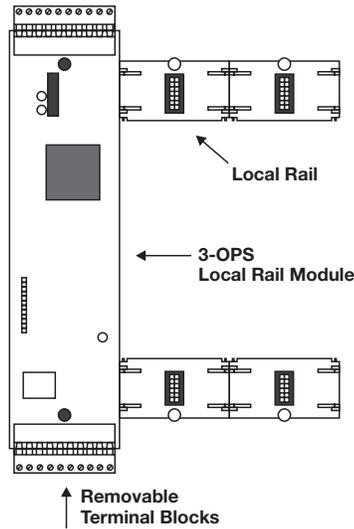

## Specifications

Operating Current	53 mA
Standby Current	147 mA
Mounting	One Local Rail Space
Terminal Size	18-12 AWG (1.0mm <sup>2</sup> - 2.5mm <sup>2</sup> )
Approvals	UL, ULC


## Ordering Information

Catalog Number	Description	lb. (kg)
3-OPS	Off Premises Signaling module*	0.59 (.27)
4-FIL	Blank EST4 filler plate (order separately when no LED or LED/Switch module is installed on the inner door).	0.1 (.05)
3-FP	Filler Plate, order separately when no LED or LED/Switch module installed.	0.1 (.05)

\* 3-OPS cannot be mounted behind the 4-FT Fire Fighter Master Handset module.

## Installation and Mounting

### “New” Style Reverse Polarity

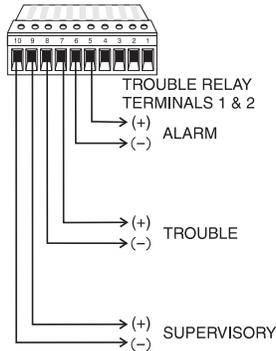

### “Old” Style Reverse Polarity

